

## Installation Manual

### 1. Description:

The equipment is used as a termination point for the feeder cable to connect with drop cable in FTTx communication network system. The fiber splicing, splitting, distribution can be done in this box, and meanwhile it provides solid protection and management for the FTTx network building.

### 2. Features:

1. Total enclosed structure.
2. Material: PC+ABS, wet-proof. water-proof. dust-proof. anti-aging, protection level up to IP65.
3. Clamping for feeder cable and drop cable, fiber splicing, fixation, storage, distribution etc., all in one.
4. Cable, pigtails, patch cords are running through own path without disturbing each other, cassette type SC adaptor installation, easy maintenance.
5. Distribution panel can be flipped up, feeder cable can be placed in a cup-joint way, easy for maintenance and installation.
6. Cabinet can be installed by the way of wall-mounted or poled-mounted, suitable for both indoor and outdoor uses.

### 3. Specification:

#### 1. Environmental requirement

Working temperature:  $-40^{\circ}\text{C} \sim +85^{\circ}\text{C}$

Relative humidity:  $\leq 85\%$  ( $+30^{\circ}\text{C}$ )

Atmospheric pressure:  $70\text{KPa} \sim 106\text{Kpa}$

Main technical datasheet Insertion loss:

$\leq 0.2\text{dB}$

UPC return loss:  $\geq 50\text{dB}$  APC

return loss:  $\geq 60\text{dB}$

Life of insertion and extraction:  $> 1000$  times

Thunder-proof technical datasheet

The grounding device is isolated with the cabinet, isolation resistance is less than

$2 \times 10^4 \text{M}\Omega / 500\text{V}$  (DC) ;  $IR \geq 2 \times 10^4 \text{M}\Omega / 500\text{V}$

The withstand voltage between grounding device and cabinet is no less than  $3000\text{V}$  (DC)

/min, no puncture, no flashover


;  $U \geq 3000\text{V}$

### 4. Configuration table:

**Table 1 Model and configuration**

Model	Description	Size (Pic 1) A*B*C(mm)	Max Capacity			Installation Size(Pic 2)
			SC	LC	PLC	D*E (mm)
8 core	Splitting /Distribution Box	227*181*54.5	8	8	8 (LC)	81*120


# Installation Manual

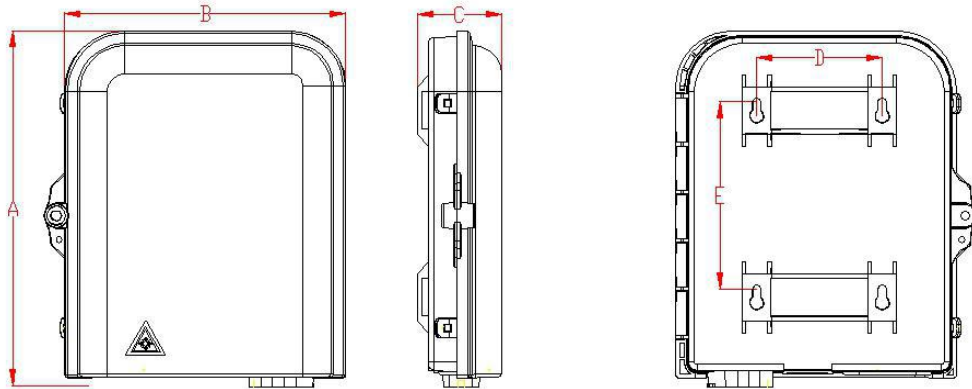


Pic 1 Box Size

Pic 2 Installation Size


## 5. Product cable ways:

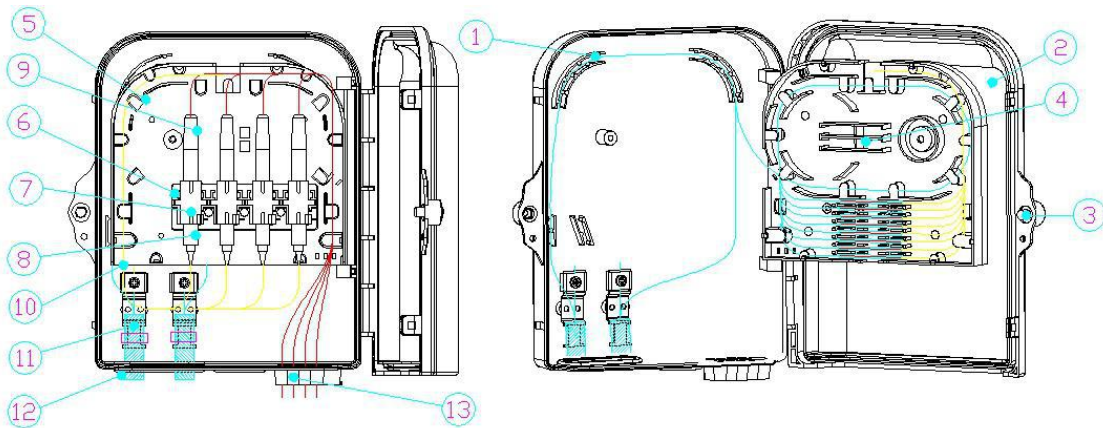

1.Base; 2.Lid; 3.Lock; 4.PLC Mounting position; 5. Splicing flap plate; 6.Adaptor assemble bracket; 7.Adaptor; 8.Pigtail; 9.Fast connector; 10.cable fixer; 11.Main cable; 12. cable entry dusty free protector; 13.Dust-free blocker

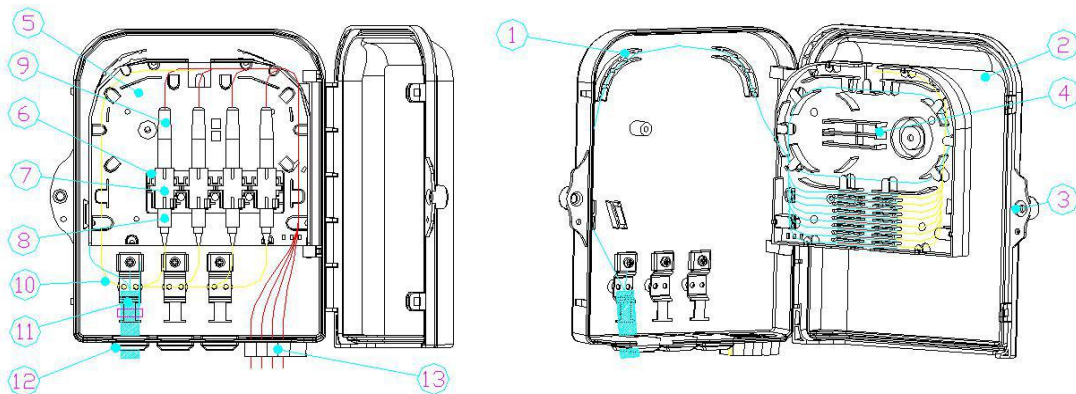

1.Base; 2.Lid; 3.Key; 4.PLC assembling location; 5.Splicing flap plate; 6.Adaptor assembling bracket; 7.Adaptor; 8.Pigtail; 9.Fast connector; 10.Fiber reinforce fixer; 11.Main cable; 12.Cable entry dust-free blocker; 13. Dust-free blocke

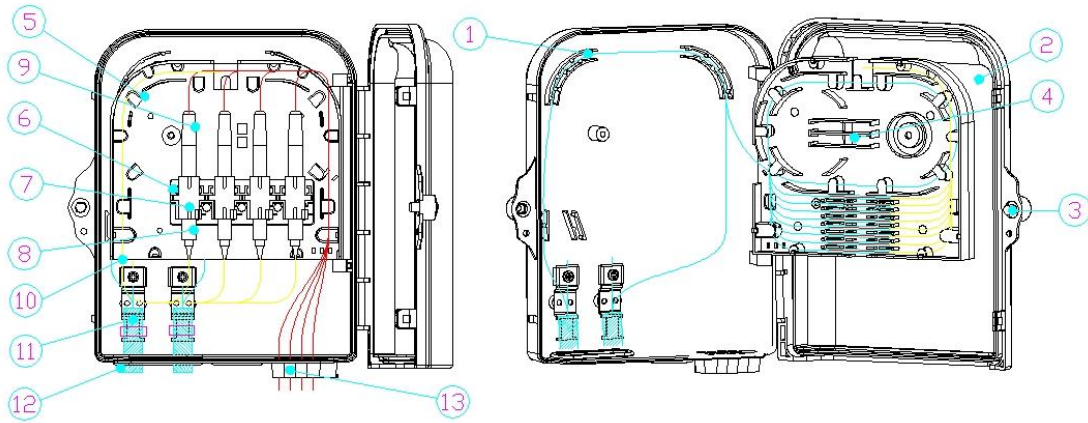

1.Base; 2.Lid; 3.Key; 4.PLC assembling location; 5.Splicing flap plate; 6.Adaptor assembling bracket; 7.Adaptor; 8.Pigtail; 9.Fast connector; 10.Fiber reinforce fixer; 11.Main cable; 12.Cable entry dust-free blocker; 13. Dust-free blocker

**Pic 3 Cable ways**


**6. Installation:**

1. Wall-mounted installation

Drill 4 holes over the wall based on the size in table 1, place the expansion bolt  $\Phi 5.5 \times 30$ , place the box to match up the holes and use bolt to fasten. (Pic 4)

2. Pole-mounted installation

Fix 1 set of the easy pole ring to the telecom pole . (Pic 5)

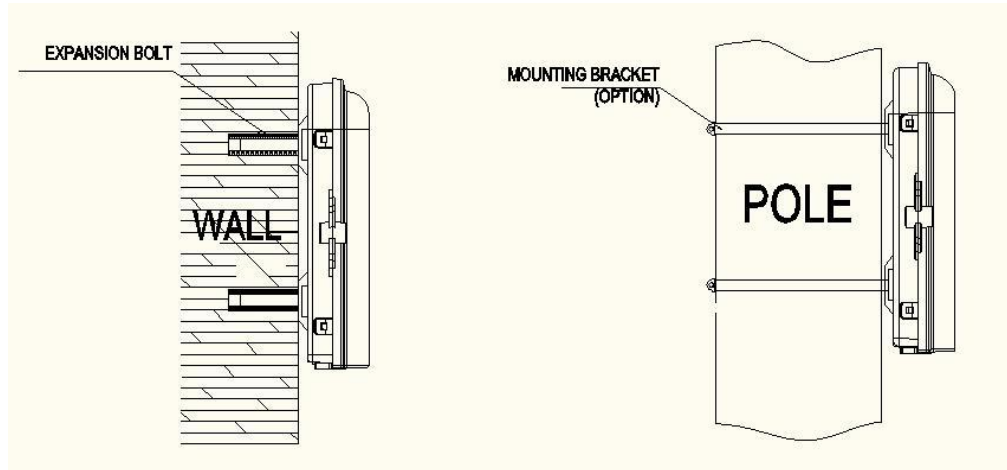

**Pic 4 Wall mounted installation**

**Pic 5 Pole mounted installation**

7. Accessories:

Users' Manual\*1.

Accessories Bag \* 1